

REMOVAL OF BOIL WATER ADVISORY


SUMAS PRAIRIE WATER SYSTEM

Issued December 20, 2021

WATER SUPPLY SYSTEM COVERED BY THIS ADVISORY

This notice applies to the **Existing Advisory Area of Sumas Prairie Water Distribution System** supporting the following area:

Angus Campbell Rd to the west, Hwy 1 to the north, Chilliwack/Abbotsford border to the east, Canada/US Border, Old Yale Rd to the south

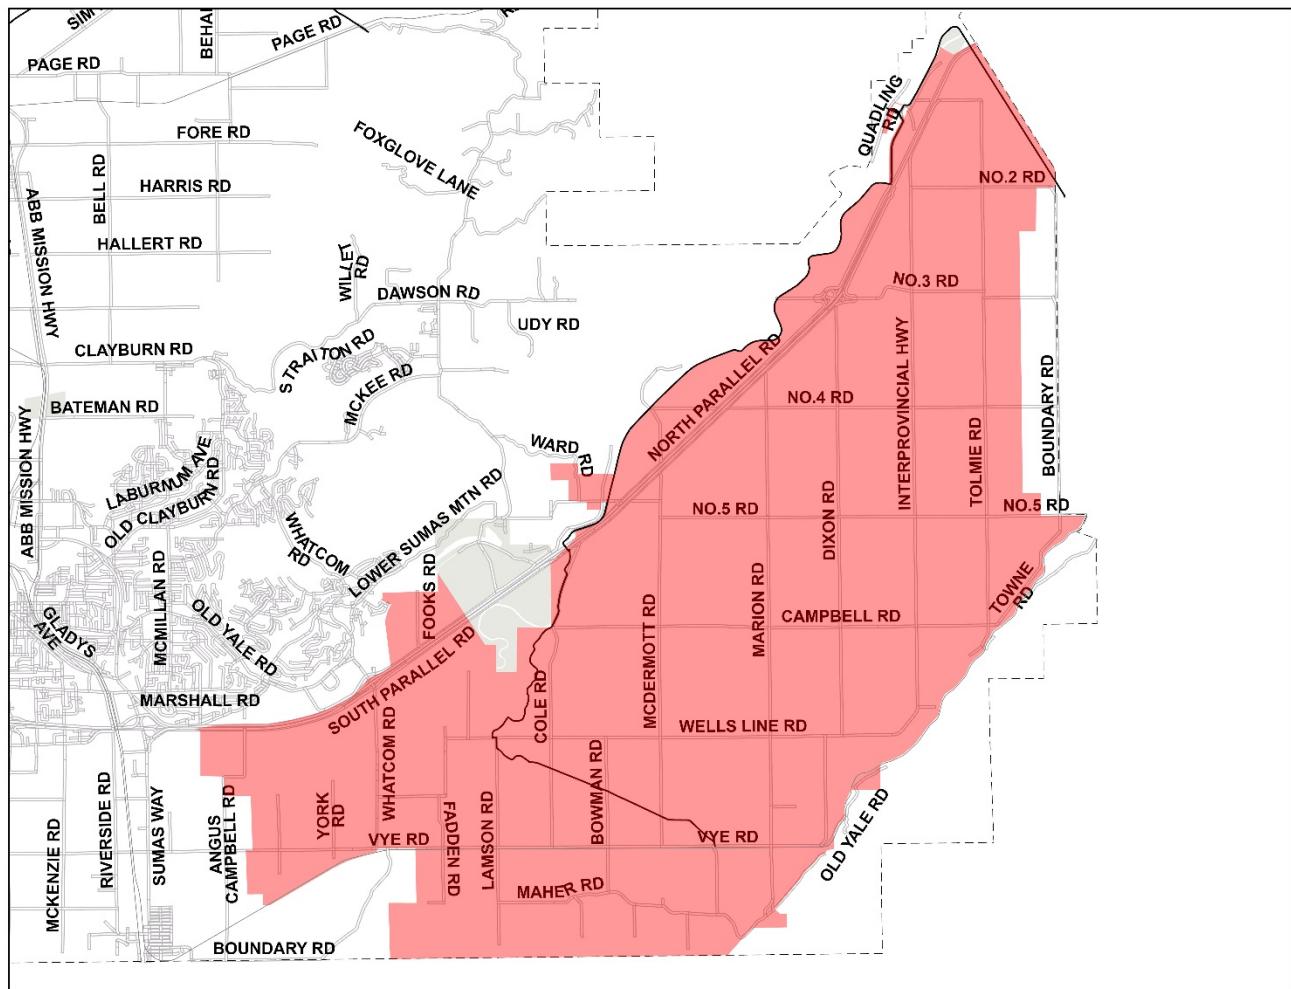

REASON FOR THIS NOTICE: Removal of Boil Water Advisory

In conjunction with Fraser Health Authority, the Boil Water Advisory for the Sumas Prairie is now rescinded. Consecutive sampling results show that the water in the Sumas Prairie system meets regulatory water quality requirements and normal water usage can be resumed. The water no longer needs to be boiled prior to use for drinking, food preparation and other domestic purposes.

RECOMMENDATIONS

I can use my water again. What should I do now?

- Using a high flow rate, flush the cold water tap nearest the location where your water service enters your house for a minimum of 5 minutes or until a noticeable difference in temperature is observed. This will flush your water line from the water supply main to your house.
- Using a high flow rate, flush each hot and cold water tap for 2 minutes.
- If applicable, inspect tap aerators and rinse free of any debris prior to reinstalling.
- Change any drinking water filters.
- If you are experiencing any issues with appliances or devices, such as hot water tanks, dishwashers, washing machines or valves, you may need to contact a qualified professional to verify proper operation.

QUESTIONS

If you have any questions concerning the Notice, please contact: City of Abbotsford Operations Yard at 604-853-5485.

If you have any questions concerning the Public Health Impacts of this notice, please contact: Fraser Health Authority by email at HPAbbotsford@fraserhealth.ca